


# UMG 104

Energy measurement device for DIN rails

Harmonics



Measurement accuracy 0.5

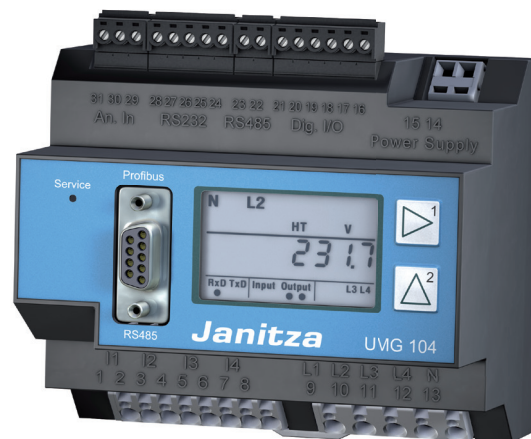

Temperature input



Memory 4 MByte

### Communication

- Profibus (DP / V0 – optional)
- Modbus RTU

### Interfaces

- RS232
- RS485

### Accuracy of measurement

- Energy: Class 0.5S (... / 5 A)
- Current: 0.2 %
- Voltage: 0.2 %

### Power quality

- Harmonics up to 40th harmonic
- Unbalance, rotary field indication
- Distortion factor THD-U / THD-I

### Networks

- IT, TN, TT networks
- 3 and 4-phase networks
- Up to 4 single-phase networks

### Temperature measurement

- PT100, PT1000, KTY83, KTY84

### Network visualisation software

- Free GridVis®-Basic

### 2 digital inputs


- Pulse input
- Signalling input logic
- State monitoring

### 2 digital outputs

- Pulse output kWh / kvarh
- Switch output
- Threshold value output
- Logic output

### Measured data memory

- 4 MByte Flash (156,000 measured values)

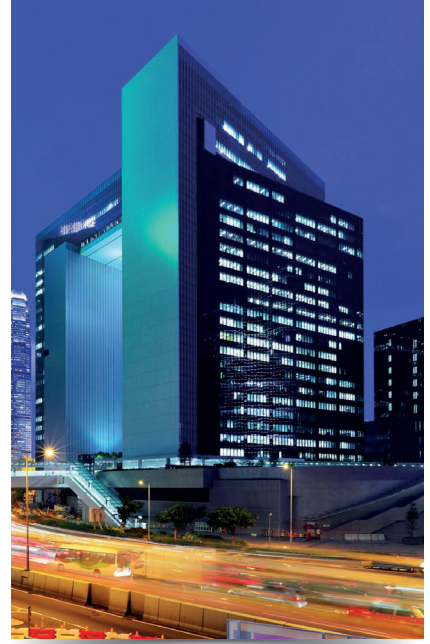

# Areas of application



- Consumption data acquisition and evaluation (load profiles, load curves)
- Continuous power quality monitoring
- Cost centre accounting of energy costs
- Network protection
- Measured value transducer for building management systems or PLC

# Main features



## Power quality

- Harmonics analysis up to 40th harmonic
- Unbalance
- Rotary field indication
- Distortion factor THD-U /THD-I
- Measurement of positive, negative and zero sequence component

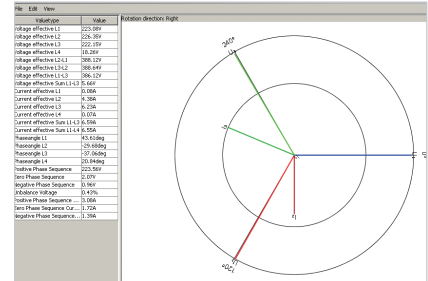


Fig.: GridVis® – Phasor diagram



## High-speed Modbus

- Fast and reliable data exchange via RS485 interface
- Speed up to 921.6 kB/s

## Secure and rapid communication via Modbus and Profibus

- Rapid, cost-optimised and reliable communication in existing Fieldbus architectures
- Integration in PLC systems and building management systems
- High flexibility due to the use of open standards

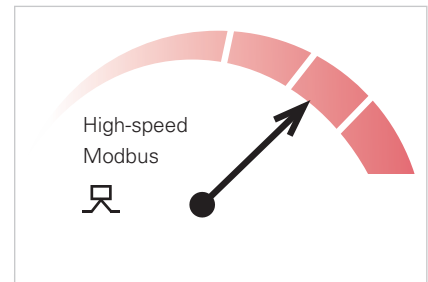


Fig.: High-speed Modbus



## Large measurement data memory

- 4 MByte
- 156,000 saved values
- Recording range dependent on the user-defined measurement data memory configuration over a few months
- Recording freely configurable

**Added value through additional functions**

The UMG 104 goes far beyond the limits of digital multifunction measurement devices thanks to the integration of additional functions:

- Multifunction measurement device
- State monitoring
- Data logger
- Meters (kWh, kvarh)
- Temperature monitoring
- Harmonics analyser

Due to the four current and voltage inputs there are also particular advantages with the monitoring of up to four single-phase outputs, e.g. in data centres, offices or single-phase motor outputs.


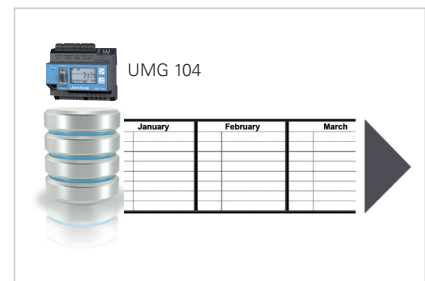


Fig.: Large measurement data memory




**Dimension diagrams**

All dimensions in mm

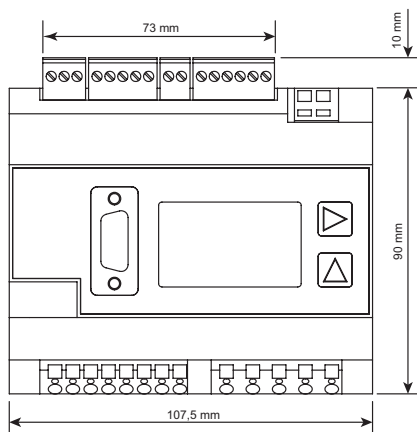


Front view

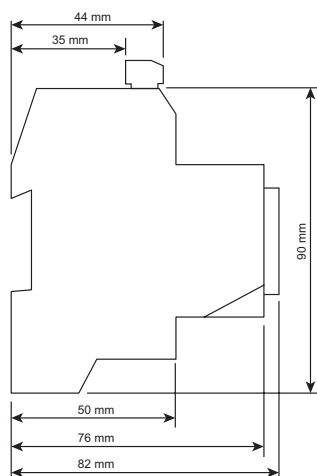

Side view



## Typical connection

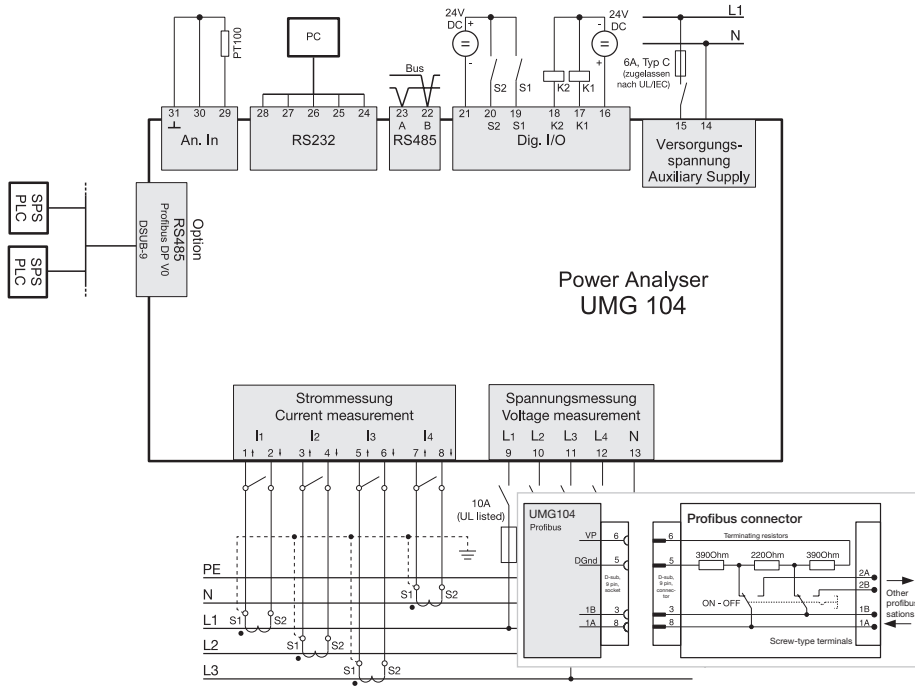

## Device overview and technical data

	UMG 104			UMG 104P
Item number	52.20.201	52.20.003	52.20.205	52.20.202
Item number (UL)	52.20.201	-	52.20.205	52.20.202
Supply voltage AC	95 ... 240 V AC	50 ... 110 V AC	20 ... 50 V AC	95 ... 240 V AC
Supply voltage DC	135 ... 340 V DC	50 ... 155 V DC	20 ... 70 V DC	135 ... 340 V DC
<b>Communication</b>				
<b>Interfaces</b>				
RS485: 9.6 – 921.6 kbps (Screw-type terminal)	•	•	•	•
RS232: 9.6 – 115.2 kbps (Screw-type terminal)	•	•	•	•
Profibus DP: Up to 12 Mbps (DSUB-9-socket)	-	-	-	•

General	
Use in low and medium voltage networks	•
Accuracy voltage measurement	0.2 %
Accuracy current measurement	0.25 %
Accuracy active energy (kWh, .../5 A)	Class 0.5S
Number of measurement points per period	400
Uninterrupted measurement	•
<b>RMS - momentary value</b>	
Current, voltage, frequency	•
Active, reactive and apparent power / total and per phase	•
Power factor / total and per phase	•

Comment: For detailed technical information please refer to the operation manual and the Modbus address list.

• = included - = not included

An RS232 connecting cable is not included in the delivery and must be ordered separately as item no. 08.02.427.

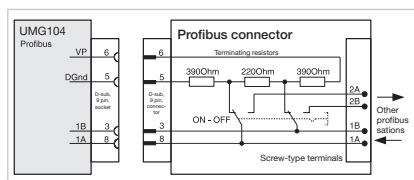


Fig.: Profibus connector, contact allocation

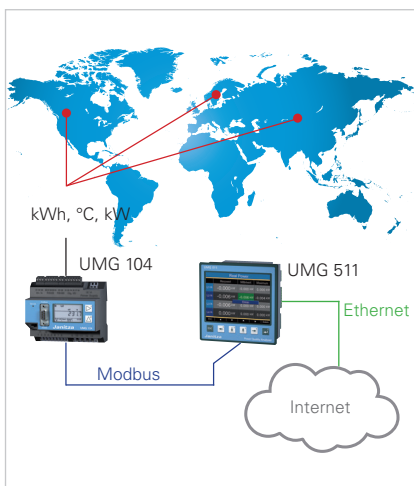


Fig.: Word-wide remote monitoring of the energy consumption and temperature for various different locations

Comment: For detailed technical information please refer to the operation manual and the Modbus address list.

• = included - = not included

\*1 Optional additional functions with the packages GridVis®-Professional, GridVis®-Service and GridVis®-Ultimate.

\*2 The UMG104 can only detect measurement values if a voltage L-N larger than 10 Veff or a voltage L-L larger than 18 Veff is applied to at least one voltage measurement input.

<b>Energy measurement</b>	
Active, reactive and apparent energy [L1,L2,L3, L4, Σ L1–L3, Σ L1–L4]	•
<b>Recording of the mean values</b>	
Voltage, current / actual and maximum	•
Active, reactive and apparent power / actual and maximum	•
Frequency / actual and maximum	•
Demand calculation mode (bi-metallic function) / thermal	•
<b>Other measurements</b>	
Clock	•
<b>Power quality measurements</b>	
Harmonics per order / current and voltage	1st – 40th
Harmonics per order / active and reactive power	1st – 40th
Distortion factor THD-U in %	•
Distortion factor THD-I in %	•
Voltage unbalance	•
Rotary field indication	•
Current and voltage, positive, zero and negative sequence component	•
<b>Measured data recording</b>	
Memory (Flash)	4 MB
Average, minimum, maximum values	•
Measured data channels	4
Alarm messages	•
Time stamp	•
Time basis average value	freely user-defined
RMS averaging, arithmetic	•
<b>Displays and inputs / outputs</b>	
LCD display	•
Digital inputs	2
Digital outputs (as switch or pulse output)	2
Thermistor input (PT100, PT1000, KTY83, KTY84)	•
Voltage and current inputs	every 4
Password protection	•
<b>Communication</b>	
<b>Protocols</b>	
Modbus RTU	• / •
Profibus DP V0	- / •
<b>Software GridVis®-Basic*1</b>	
Online graphs	•
Databases (Janitza DB, Derby DB); MySQL, MS SQL with higher GridVis® versions)	•
Manual reports (energy, power quality)	•
Topology views	•
Manual read-out of the measuring devices	•
Graph sets	•
<b>Programming / threshold values / alarm management</b>	
Comparator (2 Groups with 4 comparators each)	•
<b>Technical data</b>	
Type of measurement	Constant true RMS Up to 40th harmonic
Nominal voltage, three-phase, 4-conductor (L-N, L-L)	277 / 480 V AC
Nominal voltage, three-phase, 3-conductor (L-L)	480 V AC
Measurement in quadrants	4
Networks	TN, TT, IT
Measurement in single-phase / multi-phase networks	1 ph, 2 ph, 3 ph, 4 ph and up to 4 times 1 ph
<b>Measured voltage input</b>	
Overvoltage category	300 V CAT III
Measurement range, voltage L-N, AC (without potential transformer)	0 <sup>2</sup> ... 600 Vrms
Measurement range, voltage L-L, AC (without potential transformer)	0 <sup>2</sup> ... 1,000 Vrms
Resolution	0.01 V
Impedance	4 MOhm / phase
Frequency measuring range	45 ... 65 Hz
Power consumption	approx. 0.1 VA
Sampling frequency	20 kHz / phase

<b>Measured current input</b>	
Rated current	1 / 5 A
Resolution	1 mA
Measurement range	0.005 ... 8.5 Amps
Overvoltage category	300 V CAT III
Measurement surge voltage	4 kV
Power consumption	approx. 0.2 VA (Ri = 5 MOhm)
Overload for 1 sec.	100 A (sinusoidal)
Sampling frequency	20 kHz
<b>Digital inputs and outputs</b>	
Number of digital inputs	2
Maximum counting frequency	20 Hz
Input signal present	18 ... 28 V DC (typical 4 mA)
Input signal not present	0 ... 5 V DC, current < 0.5 mA
Number of digital outputs	2
Switching voltage	max. 60 V DC, 30 V AC
Switching current	max. 50 mA Eff AC / DC
Pulse output (energy pulse)	max. 20 Hz
Maximum cable length	up to 30 m unscreened, from 30 m screened
<b>Mechanical properties</b>	
Weight	350 g
Device dimensions in mm (H x W x D)	90 x 107.5 x approx. 82
Battery	Type Lithium CR2032, 3 V
Protection class per EN 60529	IP20
Assembly per IEC EN 60999-1 / DIN EN 50022	35-mm DIN rail
Connecting phase (U / I), Single core, multi-core, fine-stranded Terminal pins, core end sheath	0.08 to 2.5 mm <sup>2</sup> 1.5 mm <sup>2</sup>
<b>Environmental conditions</b>	
Temperature range	Operation: K55 (-10 ... +55 °C)
Relative humidity	Operation: 5 to 95 % (at 25 °C)
Operating height	0 ... 2,000 m above sea level
Degree of pollution	2
Installation position	user-defined
<b>Electromagnetic compatibility</b>	
Electromagnetic compatibility of electrical equipment	Directive 2004/108/EC
Electrical appliances for application within particular voltage limits	Directive 2006/95/EC
<b>Equipment safety</b>	
Safety requirements for electrical equipment for measurement, regulation, control and laboratory use – Part 1: General requirements	IEC/EN 61010-1
Part 2-030: Particular requirements for testing and measuring circuits	IEC/EN 61010-2-030
<b>Noise immunity</b>	
Industrial environment	IEC/EN 61326-1
Electrostatic discharge	IEC/EN 61000-4-2
Voltage dips	IEC/EN 61000-4-11
<b>Emissions</b>	
Class B: Residential environment	IEC/EN 61326-1
Radio disturbanc voltage strength 30 – 1000 MHz	IEC/CISPR11/EN 55011
Radiated interference voltage 0.15 – 30 MHz	IEC/CISPR11/EN 55011
<b>Safety</b>	
Europe	CE labelling
USA and Canada	UL variants available
<b>Firmware</b>	
Firmware update	Update via GridVis <sup>®</sup> software. Firmware download (free of charge) from the website: <a href="http://www.janitza.com">http://www.janitza.com</a>

Comment:  
For detailed technical information please refer to the operation manual and the Modbus address list.

• = included - = not included